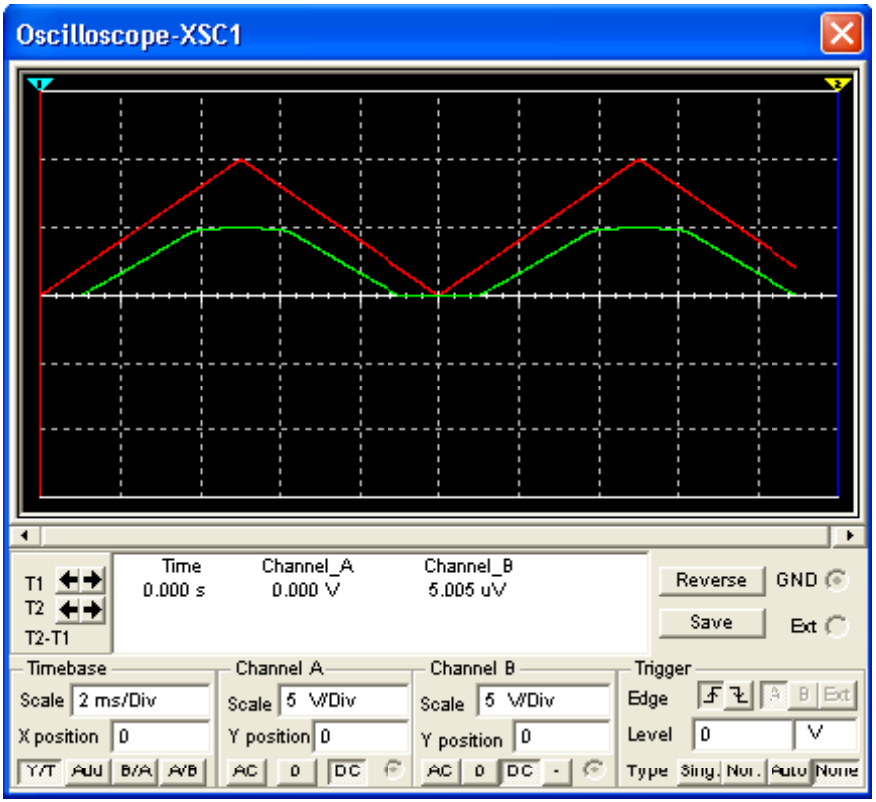
Oscilloscope-XSC1
T1
T2
T2-T1
Time
0.000 s
Channel_A
0.000 V
Channel_B
5.005 uV
Reverse
GND
Save
Ext
Timebase
Scale 2 ms/Div
X position 0
Y/T Add B/A A/B
Channel A
Scale 5 V/Div
Y position 0
AC 0 DC
Channel B
Scale 5 V/Div
Y position 0
AC 0 DC -
Trigger
Edge
A B Ext
Level 0 V
Type Sing. Nor. Auto None

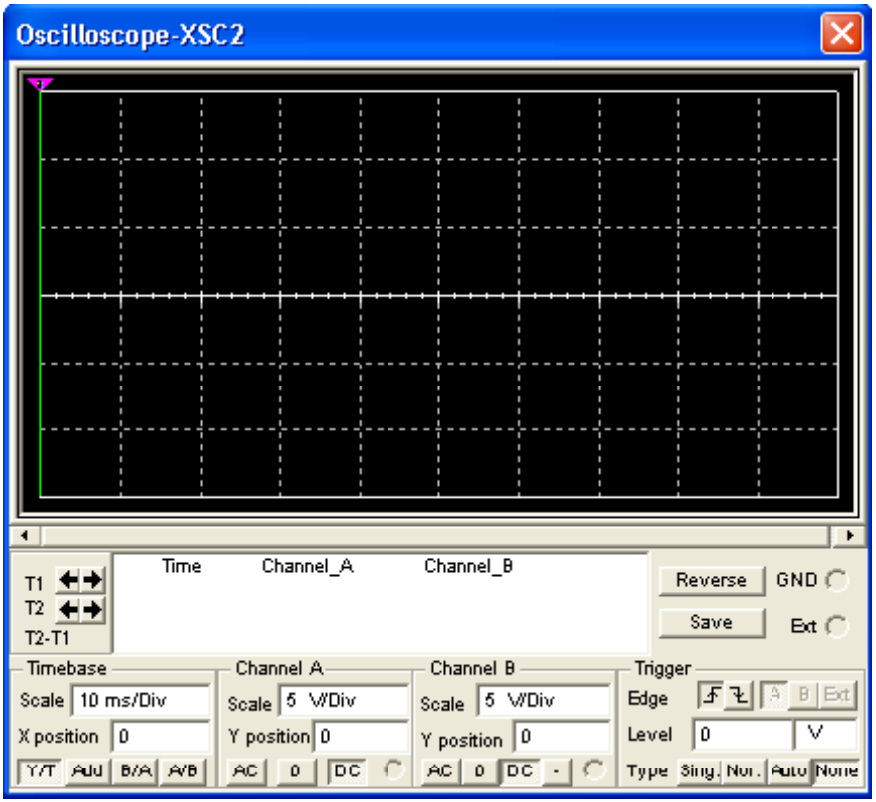
Oscilloscope-XSC2
T1
T2
T2-T1
Time
Channel_A
Channel_B
Reverse
GND
Save
Ext
Timebase
Scale 10 ms/Div
X position 0
Y/T Add B/A A/B
Channel A
Scale 5 V/Div
Y position 0
AC 0 DC
Channel B
Scale 5 V/Div
Y position 0
AC 0 DC -
Trigger
Edge
A B Ext
Level 0 V
Type Sing. Nor. Auto None